


Totara Valley Rural Distributed Energy Project

Alister Gardiner
Industrial Research Limited
Christchurch
New Zealand
a.gardiner@irl.cri.nz




brilliant **Ideas**
at work

Project Status and
Some Lessons
Learned

Prepared for: Nagoya 2007 Symposium on Microgrids Date: 6 April 07

Where in the World Are We?

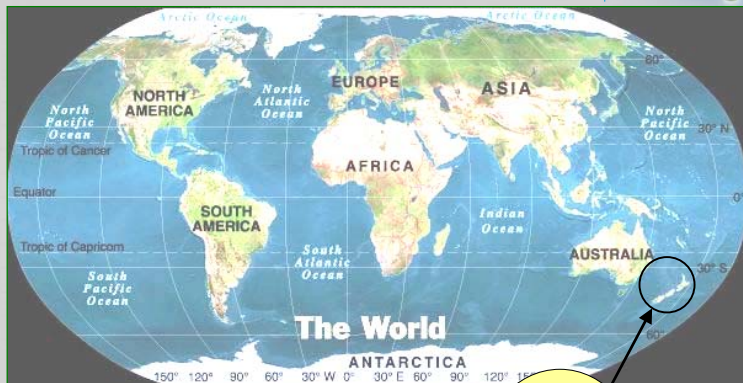

Population: 4 million

Land Area: 265,600 sq km

1920 km from Australia





New Zealand

New Zealand Energy Supply




- **A very small component of the world supply**
 - Total energy CO₂ emissions in 2005 were estimated at 35,910kt

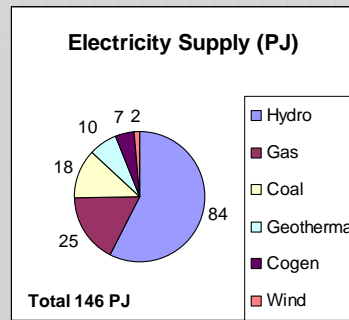
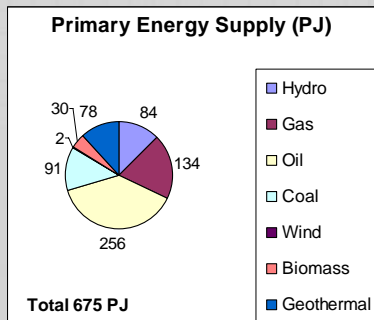


3

New Zealand Energy Demand



- **Electricity Trends**
 - Increase 1.8%/yr
 - 9% lost in transmission and distribution
 - Renewable supply 24,000 GWh, (63%) and reducing

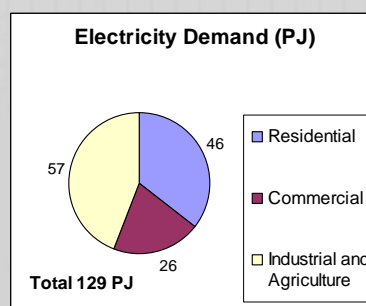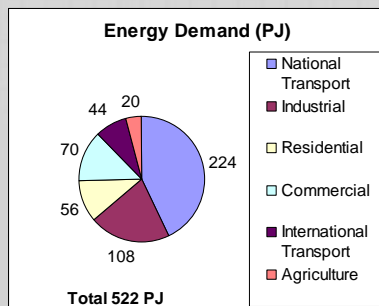


4

New Zealand Distribution System

Map showing electricity grid exit points and major nodes

Average statistics


- 22 Consumers per km MV line
- SAIDI = 140min
- Wholesale price 7.4NZc
- Residential price 16.5NZc
- Distribution charge 4.5 NZc
- CO₂-eq from sector 7,668kt

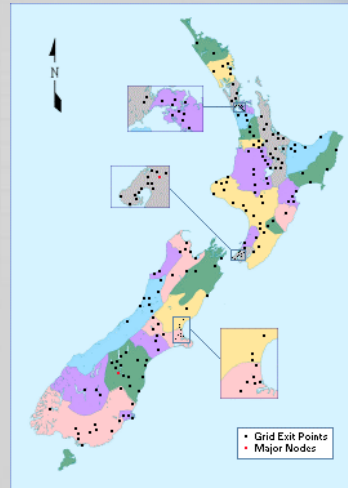

5

Regulatory Environment for Distributed Generation


Supply Industry Structure

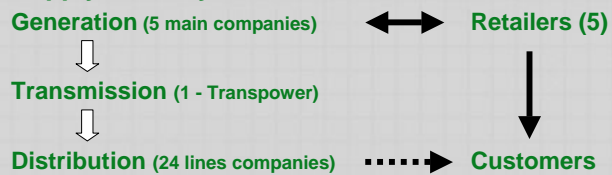

Proposed distributed generation regulations (mid 2007?)


- Simplified transaction costs for connection of < 10kW/40,000kWh
- Export kWh meter required
- Export price negotiated with Retailer
- 2013 cessation of obligation to supply

6



Distributed Generation Vision

- Through weight of numbers Microscale DE will deliver a network transformation

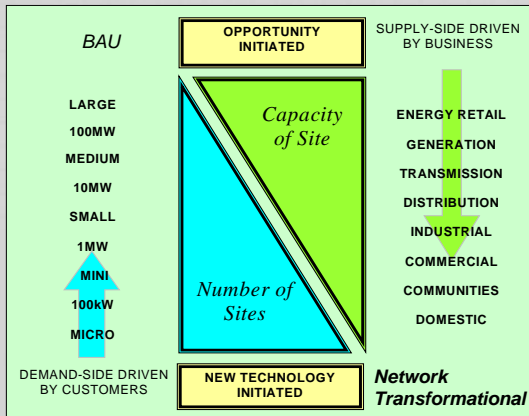


- Large scale DG is supply side / business driven
- Small scale DG will be demand side driven, but will be influenced by supply side strategies
- A market framework that recognises the value of the full range of DG opportunities is necessary

7


Status of DG and RAPS

- Supply Industry**
 - Modest overall interest – wait and see attitude
- Government regulatory/operational position**
 - “Let the market decide”
 - Recent signs of a more proactive approach
- Government funded research activities**
 - Two small rural DG demonstration projects
 - Two small Maori RAPS Projects
- The rural DG projects**
 - Totara Valley – IRL and Massey University (6 years)
 - Power to the Coast - IRL and Ngati Pooru Hauora (4 years)
 - Resource assessment (solar, wind, microhydro, geothermal)
 - Demonstration: 2kW rooftop solar PV, 5 microwind turbines


8



Totara Valley DE Project

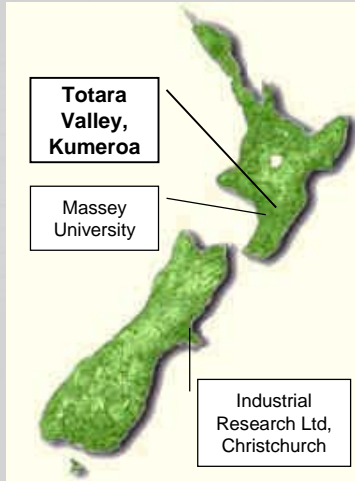


A Typical Rural NZ Location




The Totara Valley Site

Case study site - 3 farms: 5 houses


- **Involvement from**
 - The Residents
 - Massey University
 - Industrial Research Ltd
 - Scanpower (distributor)
 - Consortium of 8 distribution companies
 - Mainpower

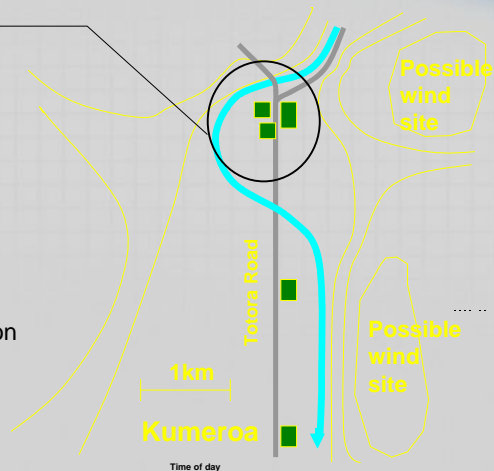





Purpose and Status


- **IRL**
 - Vision - development of microgrids
 - Pilot site for technology integration and demonstration
 - Study the impacts of distributed energy on rural supply
 - Local renewables integrated with fuel cell generation
- **Massey University**
 - Massey vision – self sufficiency through renewable energy
 - Student resource assessment projects
- **Status**
 - Five years into a 6 year study
 - Modestly funded – limited to small “behind the meter” renewable and demand side technologies
 - Support from a range of lines companies



Available Resources




- **Local energy resources**
 - Solar
 - Wind
 - Microhydro
 - Ambient heat
 - Biomass – wood burners in all houses
 - Liquid fuels
 - DSM and energy efficiency
- **Network electricity**
 - 11 kV 3 phase – supplied to all farms

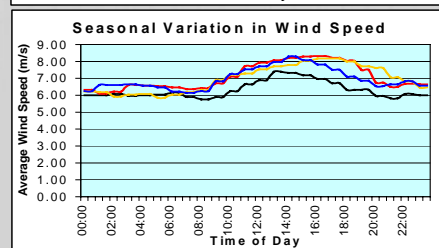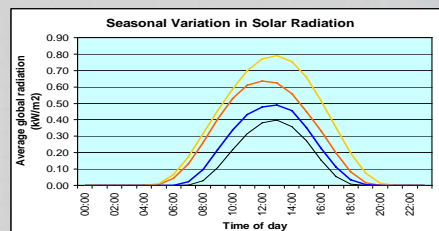



Load Monitoring

- **Electricity demand**
 - 3 farms
 - Ave 7kW, peak ADMD 25kW
- **Typical heat and power energy mix**

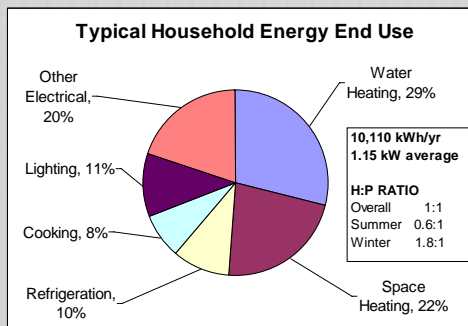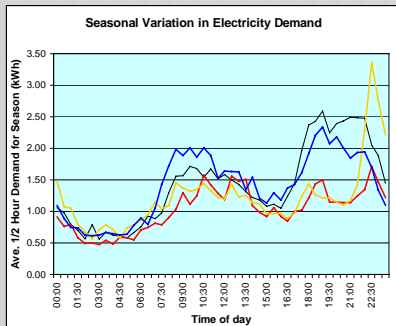

DE Technologies Installed


- **Solar**
 - 1 solar hot water system
 - 3 x 120W grid connected solar PV arrays
- **Wind**
 - 2 kW 24V WTG
- **Hydro**
 - 1 kW high head pelton wheel
- **Ambient heat**
 - 1kW hot-water heat pump
- **Biofuel**
 - 4kW 48V diesel genset
- **Total Capacity**
 - Power – 7.5kW mixed
 - Heat – about 5kW mixed






DG Injection Platform Used

- **General purpose interactive inverter platform**
 - Current mode injection from 48Vdc, externally controllable
 - 2kW modules connectable as 1, 2, 3 phase (230/400Vac)
 - Buffer battery storage – flexible energy capacity
 - Upgrade underway to improve control response time

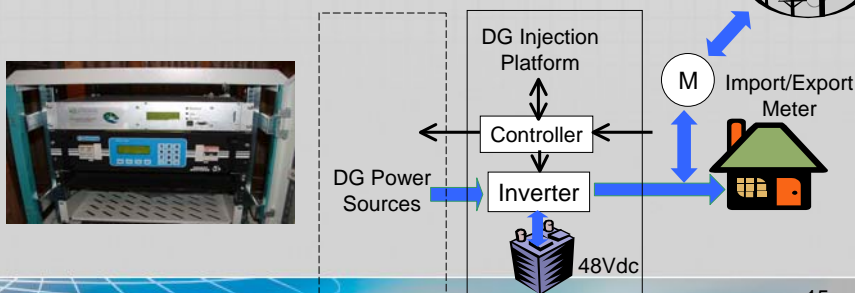

15



Experience in Brief

- Solar hot water: retrofit installation issues, performance monitoring difficult, incompatible with wetbacks – no problems since
- H/w heat pump: simple retrofit installation, compatible with wetbacks - no problems reported
- Solar PV: installation straight forward, initial operational problems of inverters tripping out resulted in supply transformer tap change – no problems since
- Wind generator: Cost of power connection prohibitive, HyLink concept being demonstrated
- Biodiesel genset: installed at a woolshed and operated automatically every day for several weeks, but not run recently due to lack of a biodiesel supply, too noisy for regular use
- Microhydro: uses an EcoSolutions pelton wheel operating at 48Vdc, consent process costly relative to return


16



Lessons to Date in Brief

- **Education, training and demonstration**
 - Good for student projects – over 10 undertaken so far
 - But site progress difficult due to discontinuity and inexperience
- **Network impacts**
 - All local generation is network connected via inverters at the household level
 - No evidence of any power quality issues to date
- **Uptake**
 - Because of regulated low fixed line charges for small users, the best option at present is to avoid exporting power
 - Only microhydro generation is economic on current kWh prices
 - Even Totara Valley is very remote when it comes to getting things fixed!

17




Plans for This Year

- **Integration of a hydrogen energy system**
 - Wind sourced hydrogen pipeline demonstration
- **Install a small microgrid system at the farm community level**
 - 3 x 6 kW inverter injection platforms (1 per farm)
 - Operate on a community or ADMD basis
- **Final project report**
 - June 2008




"The meter does run backwards!"

18



Hydrogen Energy System

- **HyLink - A hydrogen energy pipeline-store**
 - Wind generator and electrolyser at the wind site
 - 2km polymer fuel pipe
 - Fuel cell and hydrogen water heater at the farmhouse
 - System currently being installed

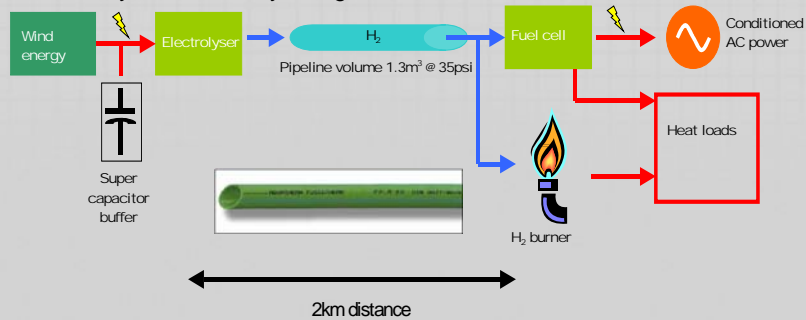


19



Small Microgrid Demonstration

- **DG can benefit the network when**
 - Projected load growth will exceed network capacity
 - Approaching the end of its useful life
 - Increased renewable energy supply is an objective
- **Intermittent renewables must be backed by firm generation**
 - Solar, wind, hydro cannot provide adequate reliability
- **Explore the microgrid concept at a community level**
 - Demonstrate network capacity and power quality support by control of 3 individual dispatchable microgeneration systems through
 - A broadcast network control signal (ripple)
 - Individual sensing of local supply undervoltage
 - Time based local demand profile smoothing
 - Revert to individual standby generation on loss of network voltage


20



Small Microgrid Demonstration

■ Demand All Farms

- Peak ½hr: 25.5 kW, peak 10min: 70kW (shearing?)
- Annual average 6.75kW, daily varies about 4 to 10kW
 - Because of winter log fires, daily ave. demand does not vary greatly
- Modest levels of storage and dispatchable generation capacity (~15kW) are required to smooth the total demand

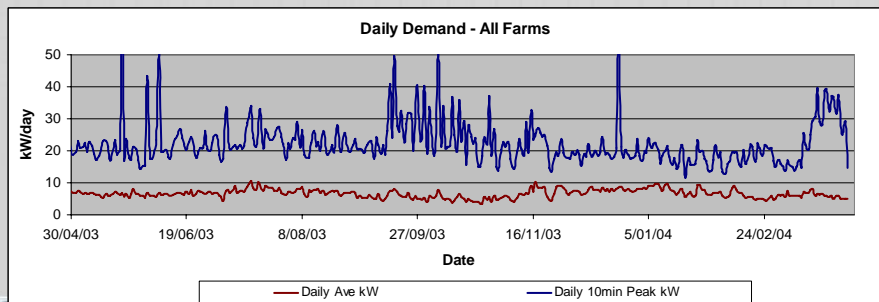

21



Small Microgrid Demonstration

■ After Diversity Maximum Demand (ADMD)

- Typical reduction

# of Houses	1	5	20	100
Ratio of MD	1	0.62	0.34	0.24

■ From load profile data

- Reduction in MD/house (7 houses) is 0.5, ie ADMD capacity/house is reduced to 50% of the individual MD/house
- ADMD, not demand at individual houses defines the network capacity limit.

■ How to determine when to turn the individual microgenerators on for network support purposes?

- Low X/R for many rural lines
- Control system design and selection of genset systems is under way

22

Network Economics and Rural DE

- **Analysis is being undertaken based on rural lines asset management plans (O&M)**
 - Methodology developed with two lines companies to assess the economics of different combinations of DG/DE for deferring upgrades
 - Assumes an increasing load will breach the feeder capacity threshold
 - Fuel based (firm) DG capacity provided in combination with wind, PV, microhydro generation or solar hot water DE
- **NPV and ROI calculated for different ratios of investment in fuel and intermittent renewable technologies**
 - 100% capacity genset with 20%, 50%, 80% parallel investment in renewable distributed energy technologies
 - Example results based on 10% demand growth to illustrate the trends

23

Network Economics and Rural DE

Example Inputs to the Model

- Applies to any regional level of assets for which an O&M plan is produced

Note(1): Planning Horizon = Furthest Extent of Asset Investment (max. = 100).

Note(2): Deferral time = Duration of DER project (1 to 30 years (max)).


Parameters	Variable	Units	
Feeder Capacity Threshold, C(T)	1,600.0	kW	
Network Finite Planning Horizon, n	40.0	years	Note(1)
(Max.) Network Investment Deferral Time, Dt	20.0	years	Note(2)
Utility Cost of Capital (Borrowing), r	10.0%	as shown	
Inflation Rate Net of Technology Progress, i	3.0%	as shown	
Capacity Deferred By Dt Years	6,473.0	kW	
PW Marginal Distribution Capacity Cost, MDCC	\$739,063.44	as shown	
PW MDCC (\$/kW/Yr)	\$99.37	\$/kW/Yr	
PW MDCC (\$/kWh/Yr)	\$0.0807	\$/kWh/Yr	

24

Network Economics and Rural DE

Example Outputs


- Fuel Price: \$1.00/l increasing at 5%/yr

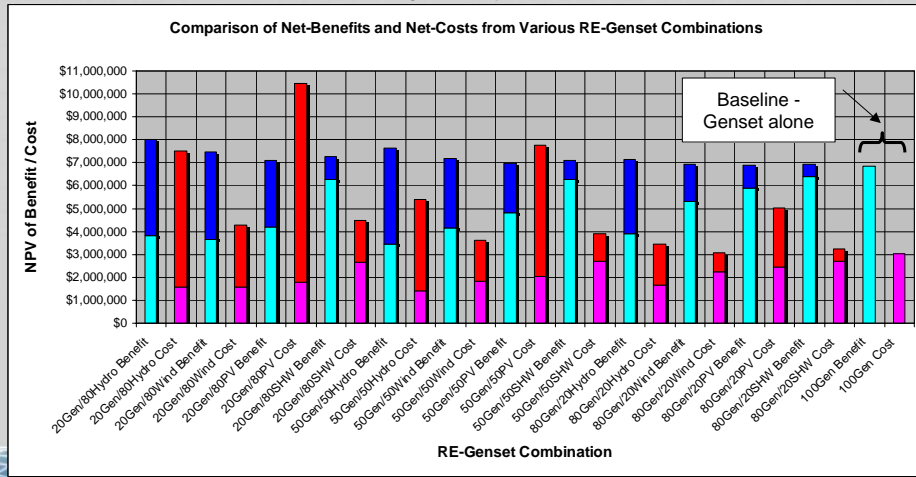

Network Economics and Rural DE

Example Outputs

- A mix of wind distributed generation and diesel gensets

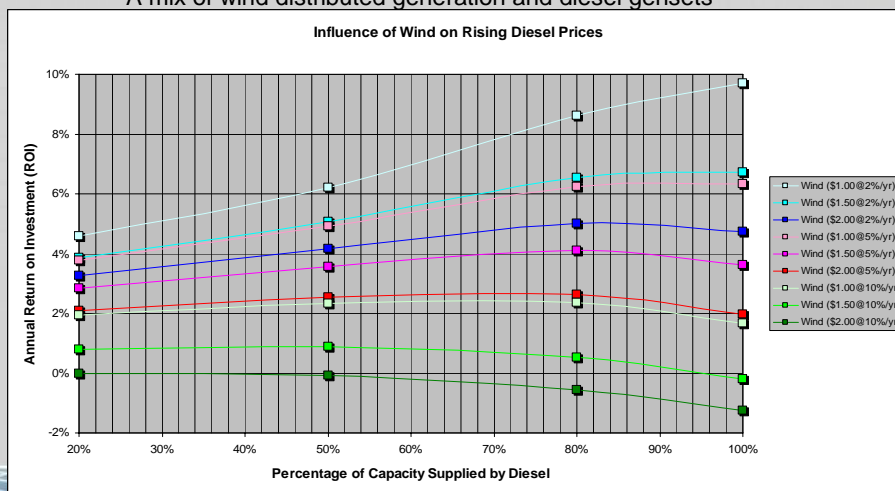



Network Economics and Rural DE

Results

- Most combinations offer positive NPV
- Addition of renewable microgeneration generally reduces the ROI over a basic distributed diesel genset option
- In some scenarios there is a midpoint optimum combination of renewable generation because of an increasing cost of fuel
- Analysis allows quantification of the degree of government support or incentive necessary to encourage renewable DE investment as a network upgrade deferral strategy
- Suggests a way forward to support renewable DE technologies without up-front subsidies
- Results are currently being written up

(Note: the methodology and results are specific to the New Zealand electricity market, but may be transportable to others)